


POTABLE

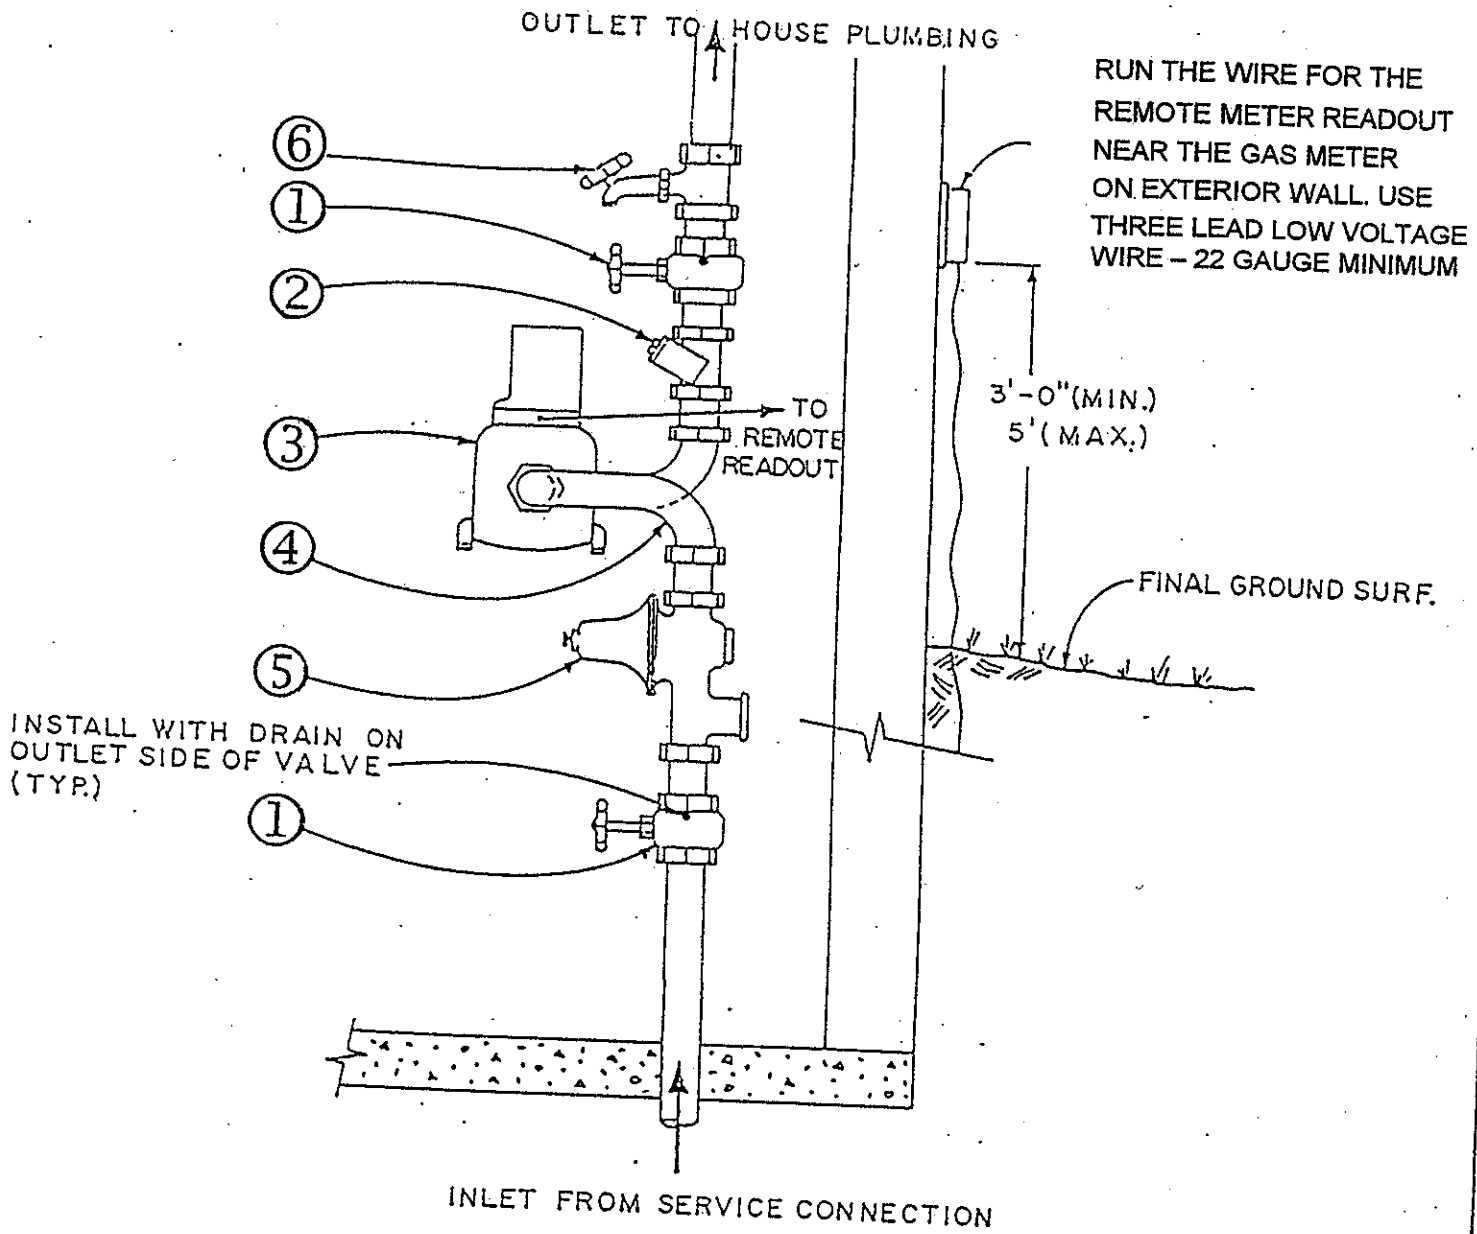

RUN THE WIRE FOR THE REMOTE METER READOUT NEAR THE GAS METER ON EXTERIOR WALL. USE THREE LEAD LOW VOLTAGE WIRE - 22 GAUGE MINIMUM

3'-0" (MIN.)
5' (MAX.)

FINAL GROUND SURF.

INSTALL WITH DRAIN ON OUTLET SIDE OF VALVE (TYP.)

INLET FROM SERVICE CONNECTION

METER SETTING STANDARDS

1. Shutoff Valve with drain - Bronze, 200 psi rating, Ball or Gate
2. Check Valve - Bronze, 200 psi rating.
3. Water Meter - 3/4" Sensus SR II with remote readout, Bronze body, 1000 gallons/pulse, 1000 gallon readout
4. Meter Yoke - Ford Copperhorn or equivalent (for full 3/4" meter)
THIS YOKE HAS TO ACCOMMODATE A 9 INCH METER.
5. Pressure Reducing Valve - Bronze, 300 psi rating, 30-70 psi minimum adjustment range, set at 50 psi
6. Hose Bib with shutoff, 200 psi rating

NOTE:

The DISTRICT will furnish and install both the inside water meter and the remote readout after the shown run is complete.

03/02

TODD CREEK FARMS
METROPOLITAN DISTRICT

METER SETTING DETAILS